




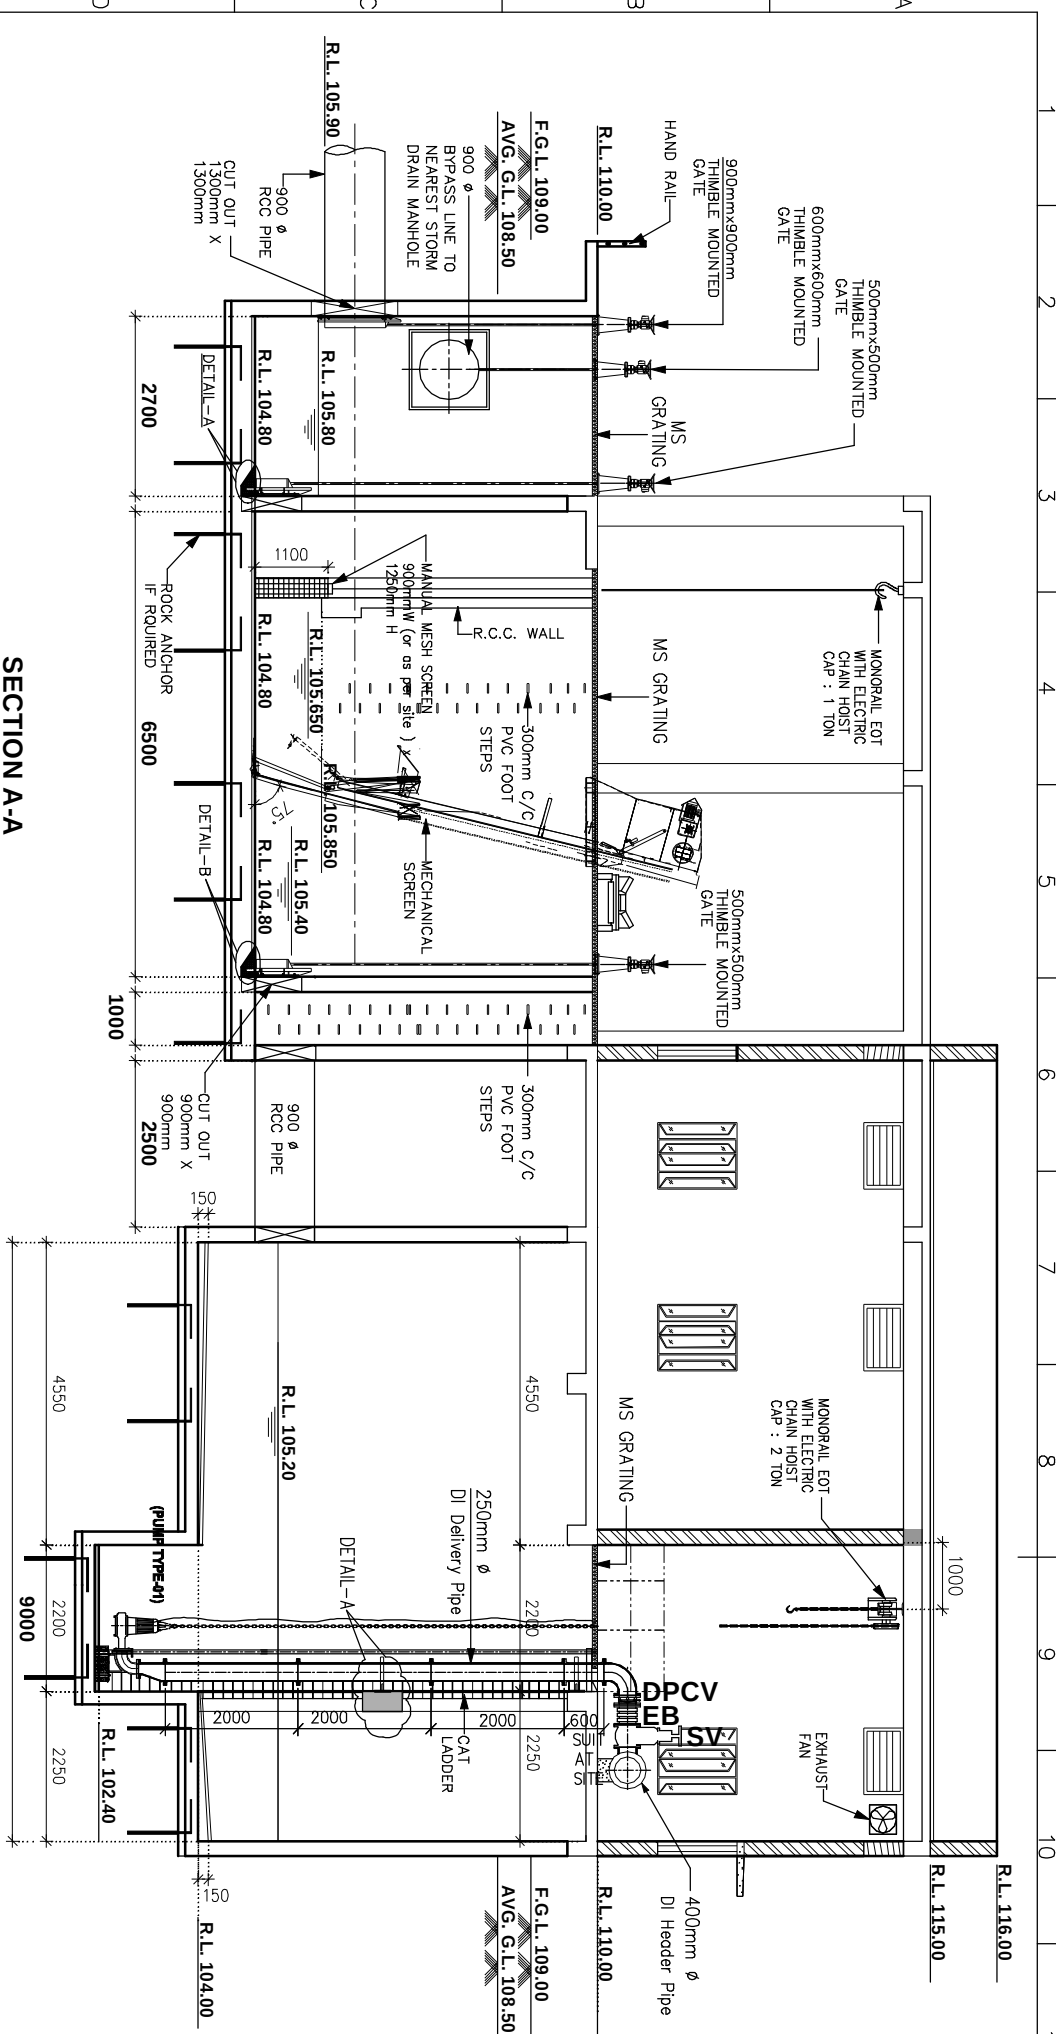


SECTION A-A
SCALE-N.T.S.

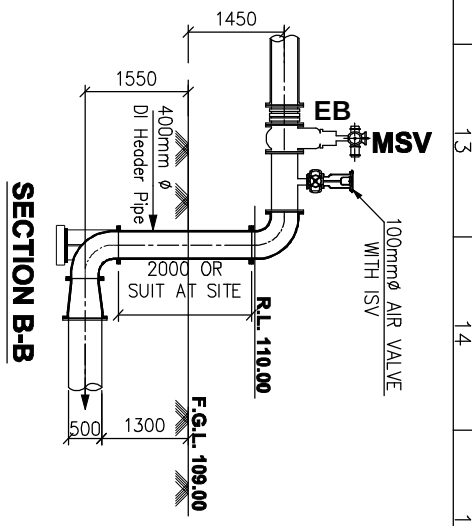


SECTION B-B

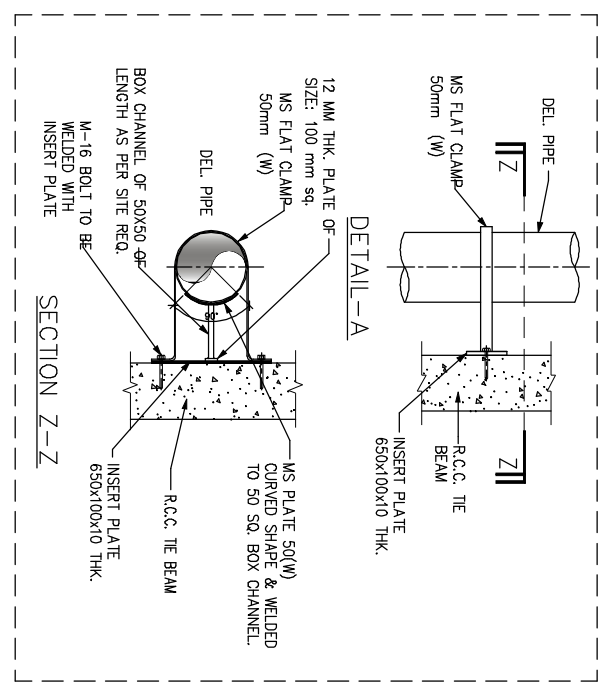

- NOTES :
- (1) ALL DIMENSIONS ARE IN MM. & LEVELS ARE IN METER.
 - (2) Foundation of Sub. NC Pumps shall be as per approved pump vendor drawing.
 - (3) Contractor to provide RCC support to pipes, fittings & valves as per instruction of E-I-C/site condition.
 - (4) Drawing is indicative & only for reference.
 - (5) Subm. NC Pump Details :
(Pump Type-01 : Cap. 285 m³/hr @ 16m Head - 2 Nos.)
(Pump Type-02 : Cap. 355 m³/hr @ 16m Head - 2 Nos.)

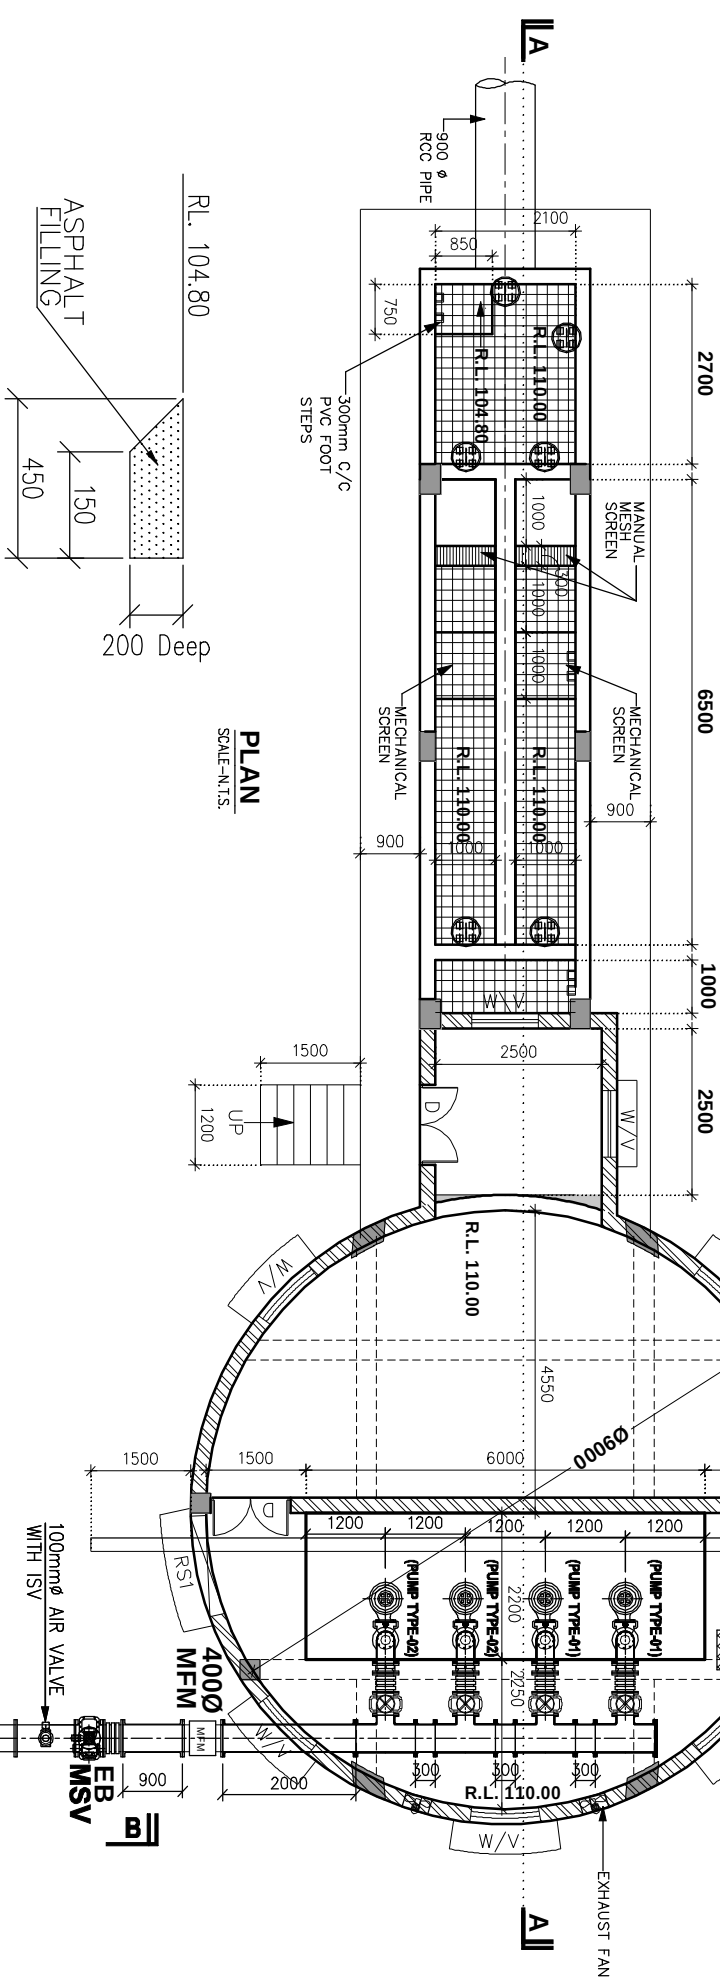

PLAN
SCALE-N.T.S.

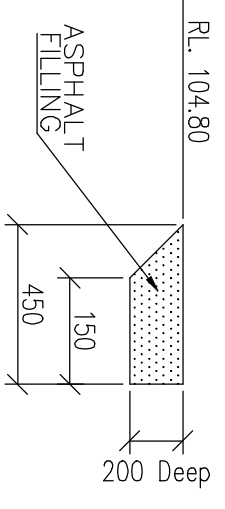

DETAIL-B

REV.	DATE	TENDER PURPOSE ONLY	JNC	RVS
RD	26.11.2022			
REV.	DATE	DESCRIPTION	REV. BY	CHK. BY
PROJCT.		SEWAGE PUMPING STATION AT MOTA MAUVA-MUNJKA AREA OF RMC		
CLIENT:		RAJKOT MUNICIPAL CORPORATION, RAJKOT		
CONSULTANTS:		SAPIENT TECHNO CONSULTANTS 701, Renbarnnd, Opp. Associated Petrol Pump, C.G.Road, Ellisbridge, Ahmedabad-380 006		
TITLE:		MECHANICAL & PIPING GAD OF SPS AT MOTA MAUVA-MUNJKA		
DRAWN BY :	JSP	DESIGNED BY :	JNC	
CHECKED BY :	RVS	PROJ. NO. :		
SCALE :	NTS	DRG. NO. :	STC/RMC/SPS-M-01	
DATE :	26.11.2022	REVISION :	R0	